



280280102-2024

m MINNESOTA POLLUTION CONTROL AGENCY

520 Lafayette Road North
St. Paul, MN 55155-4194

**Compliance inspection report form
Existing Subsurface Sewage Treatment System (SSTS)**

Doc Type: Compliance and Enforcement

Instructions: Inspection results based on Minnesota Pollution Control Agency (MPCA) requirements and attached supporting documentation – additional local requirements may also apply. Further information can be found here:
<https://www.pca.state.mn.us/sites/default/files/wq-wwists4-31a.pdf>.

Inspector must submit completed form to Local Governmental Unit (LGU) and system owner within 15 days of final determination of compliance or noncompliance.

Property information

Local tracking number: _____

Parcel ID# or Sec/Twp/Range: 280280102 Local regulatory authority: _____
Property address: 23424 White Pine Rd DL
Owner/representative: Mike Amb Owner's phone: 761-238-6872
Brief system description: 1500 comp / biofilter mound denitrified

System status

System status on date (mm/dd/yyyy): 10-14-2024

Compliant – Certificate of compliance*

Noncompliant – Notice of noncompliance

(Valid for 3 years from report date unless evidence of an imminent threat to public health or safety requiring removal and abatement under section 145A.04, subdivision 8 is discovered or a shorter time frame exists in Local Ordinance.)

An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance or under section 145A.04 subdivision 8.

***Note: Compliance indicates conformance with Minn. R. 7080.1500 as of system status date above and does not guarantee future performance.**

Systems failing to protect ground water must be upgraded, replaced, or use discontinued within the time required by local ordinance.

Reason(s) for noncompliance (check all applicable)

- Impact on public health (Compliance component #1) – *Imminent threat to public health and safety*
- Tank integrity (Compliance component #2) – *Failing to protect groundwater*
- Other Compliance Conditions (Compliance component #3) – *Imminent threat to public health and safety*
- Other Compliance Conditions (Compliance component #3) – *Failing to protect groundwater*
- System not abandoned according to Minn. R. 7080.2500 (Compliance component #3) – *Failing to protect groundwater*
- Soil separation (Compliance component #5) – *Failing to protect groundwater*
- Operating permit/monitoring plan requirements (Compliance component #4) – *Noncompliant - local ordinance applies*

Comments or recommendations

4208 66th St S
 Fargo, ND 58104

Certification

I hereby certify that all the necessary information has been gathered to determine the compliance status of this system. No determination of future system performance has been nor can be made due to unknown conditions during system construction, possible abuse of the system, inadequate maintenance, or future water usage.

By typing my name below, I certify the above statements to be true and correct, to the best of my knowledge, and that this information can be used for the purpose of processing this form.

Business name: Bergstrom Bankhoe
Inspector signature: [Signature]
(This document has been electronically signed)

Certification number: 2779
License number: 478
Phone: 218-841-9003

Necessary or locally required supporting documentation (must be attached):

- Soil observation logs
- Locally required forms
- Tank Integrity Assessment
- Operating Permit
- Other information (list): _____

1. Impact on public health – Compliance component #1 of 5

Compliance criteria:

System discharges sewage to the ground surface	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
System discharges sewage to drain tile or surface waters.	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
System causes sewage backup into dwelling or establishment.	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No

Any "yes" answer above indicates the system is an imminent threat to public health and safety.

Describe verification methods and results:

Visual

Attached supporting documentation:

- Other: _____
 Not applicable

2. Tank integrity – Compliance component #2 of 5

Compliance criteria:

System consists of a seepage pit, cesspool, drywell, leaching pit, or other pit?	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
Sewage tank(s) leak below their designed operating depth?	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
If yes, which sewage tank(s) leaks:	

Any "yes" answer above indicates the system is failing to protect groundwater.

Describe verification methods and results:

Camera in tank

Attached supporting documentation:

- Pumped at time of inspection
 Name of maintenance business: Baytown Builders
 License number of maintenance business: 478
 Date of maintenance: 10-14-24
 Existing tank integrity assessment (Attach)
 Date of maintenance (mm/dd/yyyy): _____ (must be within three years)
(See form instructions to ensure assessment complies with Minn. R. 7082.0700 subp. 4 B (1))
 Tank is Noncompliant (pumping not necessary – explain below).
 Other: _____

3. Other compliance conditions – Compliance component #3 of 5

3a. Maintenance hole covers appear to be structurally unsound (damaged, cracked, etc.), or unsecured?

Yes* No Unknown

3b. Other issues (*electrical hazards, etc.*) to immediately and adversely impact public health or safety? Yes* No Unknown

**Yes to 3a or 3b - System is an imminent threat to public health and safety.*

3c. System is non-protective of ground water for other conditions as determined by inspector? Yes* No

3d. System not abandoned in accordance with Minn. R. 7080.2500? Yes* No

**Yes to 3c or 3d - System is failing to protect groundwater.*

Describe verification methods and results:

Visual

Attached supporting documentation: Not applicable

4. Operating permit and nitrogen BMP* – Compliance component #4 of 5 Not applicable

Is the system operated under an Operating Permit? Yes No If "yes", A below is required

Is the system required to employ a Nitrogen BMP specified in the system design? Yes No If "yes", B below is required

BMP = Best Management Practice(s) specified in the system design

If the answer to both questions is "no", this section does not need to be completed.

Compliance criteria:

a. Have the operating permit requirements been met? Yes No

b. Is the required nitrogen BMP in place and properly functioning? Yes No

Any "no" answer indicates noncompliance.

Describe verification methods and results:

Attached supporting documentation: Operating permit (Attach)

5. Soil separation - Compliance component #5 of 5

Date of installation 2018 Unknown
(mm/dd/yyyy)

Shoreland/Wellhead protection/Food beverage lodging? Yes No

Attached supporting documentation:

- Soil observation logs completed for the report (Attach)
 Two previous verifications of required vertical separation (Attach)
 Not applicable (No soil treatment area)

Compliance criteria (select one):

5a. For systems built prior to April 1, 1996, and not located in Shoreland or Wellhead Protection Area or not serving a food, beverage or lodging establishment: Yes No*
 Drainfield has at least a two-foot vertical separation distance from periodically saturated soil or bedrock.

5b. Non-performance systems built April 1, 1996, or later or for non-performance systems located in Shoreland or Wellhead Protection Areas or serving a food, beverage, or lodging establishment: Yes No*
 Drainfield has a three-foot vertical separation distance from periodically saturated soil or bedrock.*

5c. "Experimental", "Other", or "Performance" systems built under pre-2008 Rules; Type IV or V systems built under 2008 Rules 7080, 2350 or 7080,2400 (Advanced Inspector License required) Yes No*
 Drainfield meets the designed vertical separation distance from periodically saturated soil or bedrock.

Indicate depths or elevations

A. Bottom of distribution media	72
B. Periodically saturated soil/bedrock	16"
C. System separation	40"
D. Required compliance separation*	76

*May be reduced up to 15 percent if allowed by Local Ordinance.

***Any "no" answer above indicates the system is failing to protect groundwater.**

Describe verification methods and results:

Upgrade requirements: (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is failing to protect groundwater, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, repaired, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.



Sewage tank integrity assessment form

Subsurface Sewage Treatment Systems (SSTS) Program

Purpose: This form may be used to certify the compliance status of the sewage tank components of the SSTS. This form is not a complete SSTS inspection report, only a tank integrity assessment, and may only certify sewage tank compliance status when entirely completed and signed by a qualified professional. SSTS compliance inspection report forms can be found at: <https://www.pca.state.mn.us/water/inspections>.

Instructions: This form may be completed, and signed, by a Designated Certified Individual (DCI) of a licensed SSTS inspection, maintenance, installation, or service provider business who personally conducts the necessary procedures to assess the compliance status of each sewage tank in the system. A copy of this information should be submitted to the system owner and be maintained by the licensed SSTS business for a period of five (5) years from the assessment date.

When this form is signed by a qualified certified professional, it becomes *necessary supporting documentation* to an Existing System Compliance Inspection Report: Compliance inspection form - Existing system (wq-wwists4-31b). This form can be found on the MPCA website at <https://www.pca.state.mn.us/water/inspections>.

The information and certified statement on this form is required when existing septic tank compliance status is determined by an individual other than the SSTS Inspector that submits an inspection report. This form represents a third party assessment of SSTS component compliance and is allowable under Minn. R. 7082.0700, subp. 4 Item (B) subitem (1). This form is valid for a period of three years beyond the signature date on this form unless a new evaluation is requested by the owner or owner's agent or is required according to local regulations. Additional Administrative Rule references for this activity can be found at Minn. R. 7082.0700, subp. 4 Items B, C, and D; 7083.0730 Item C.

Certificate of sewage tank compliance

Affirm all three statements:

- The SSTS does not contain a seepage pit, cesspool, drywell, leaching pit, or other pit.
- It does not contain a sewage tank that was designed to be watertight, but subsequently leaks below the designed operating depth.
- It does not represent an imminent safety threat by reason of unsecured, damaged, or weak maintenance hole cover(s) or other unsafe condition.

Notice of sewage tank non-compliance

Select all that apply:

- The SSTS has a seepage pit, cesspool, drywell, leaching pit, or other pit – "Failure to Protect Groundwater."
- It has a sewage tank that was designed to be watertight, but subsequently leaks below the designed operating depth – "Failure to Protect Groundwater."
- It presents a threat to public safety by reason of unsecured, damaged, or weak maintenance hole cover(s) or other unsafe condition – w"Imminent Threat to Public Health or Safety."

Company information

Company name: Bergstrom Buchho

Business license number: 478

Designated Certified Individual (DCI) information

Print name: Darryl Bergstrom


Certification number: 2779

I personally conducted the work described above as a Designated Certified Individual of a Minnesota-licensed SSTS inspection, maintenance, installation, or service provider Business. I personally conducted the necessary procedures to assess the compliance status of each sewage tank in this SSTS.

By typing/signing my name below, I certify the above statements to be true and correct, to the best of my knowledge, and that this information can be used for the purpose of processing this form.

Designated Certified Individual's signature: Darryl Bergstrom
(This document has been electronically signed.)

Date (mm/dd/yyyy): 10-14-24

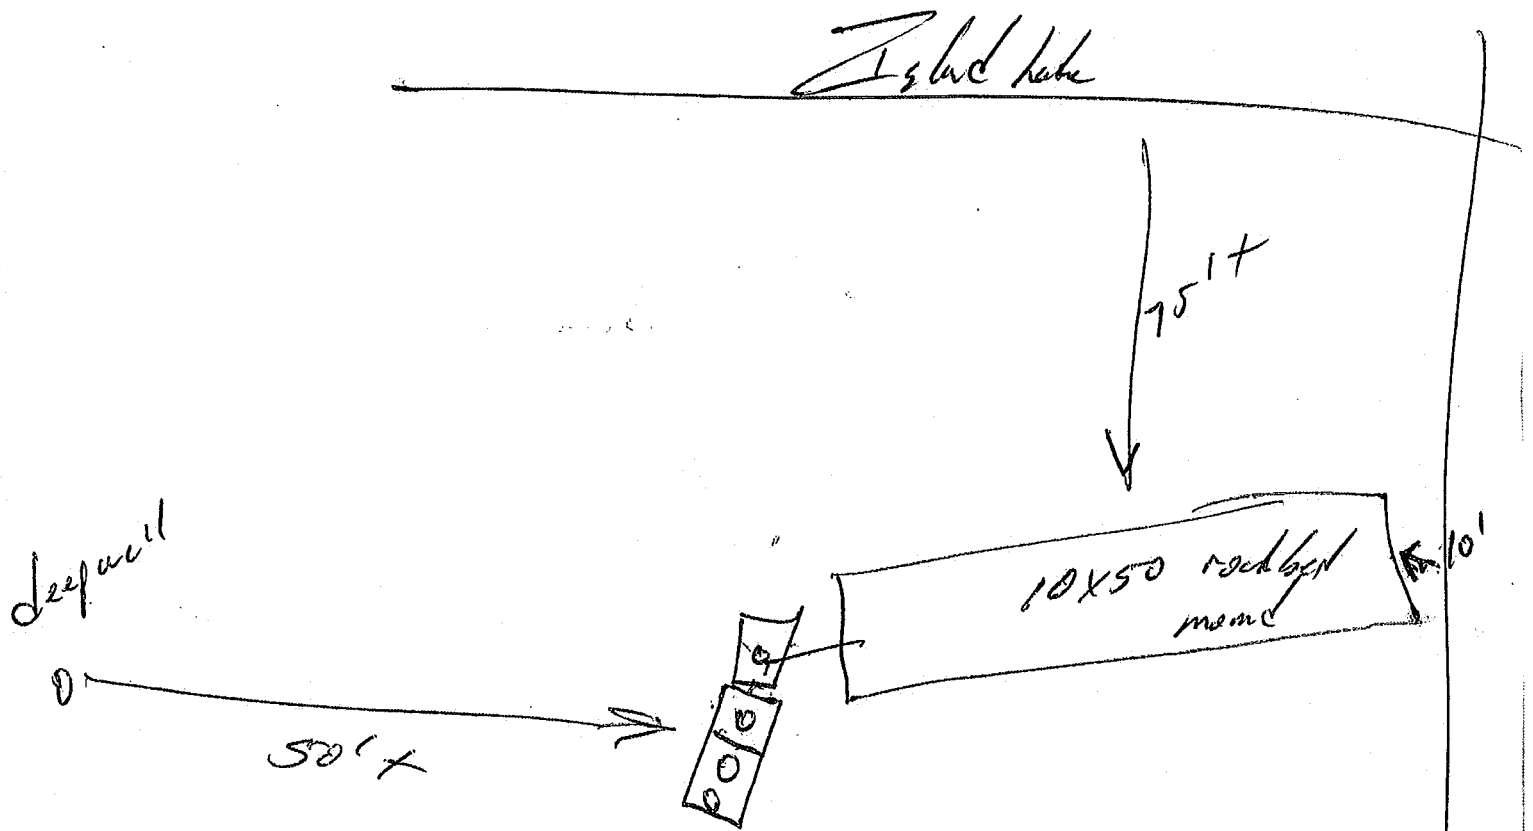

no home on site

Prop. No.

Inspection does not Guarantee or Imply
 Future Hydraulic Functioning

James E. Beyer



280280102

Certificate of Compliance Inspection Report

Last_Name: Slininger
First_Name: Jonathon
Mailing_Address: 3029 41st Ave Court S
Mailing_City: Moorhead
Mailing_State: MN
Mailing_Zip: 56560

BECKER COUNTY ZONING
915 LAKE AVE
DETROIT LAKES, MN 56501
(218) 846-7314

Parcel_Number: 280280102
Additional_Parcel:
Sec_Twn_Rge: 30-140-38
Township_Name: Shell Lake

Legal_Description: HATFIELDS POINT Block 001 LOT 2
Designer_Name_and_Li: Daryl Bergstrom L478
Inspection- Installer Name and Lic: Bergstrom Backhoe Service L478

Insp- Effluent Screen Installed:
Insp- Alarm Required: Yes
Insp- Lift Pump in System: Yes
Insp- Number of Bedrooms: -
Insp- Tank Size: 15002/c + 800
Inspection- Type_of_Drainfield: Mound
Insp- Size of Drainfield: 600
Insp- Soil Verification: +36

Insp- Tank_Dist_to_Well: 60+
Insp- Tank_Dist_to_Bldg: TBD
Insp- Tank_Dist_to_Property_Line: 10+
Insp- Tank_Dist_to_OHW: +75
Insp- Tank_Dist_to_Pressure_Line: +10
Insp- Tank_Dist_to_Wetland_Protected: -
Insp- Drainfield_Dist_to_Well: +50
Insp- Drainfield_Dist_to_Bldg: TBD
Insp- Drainfield_Dist_to_Property_Line: +10
Insp- Drainfield_Dist_to_OHW: +75
Insp- Drainfield_Dist_to_Pressure_Line: +10
Insp- Drainfield_Dist_to_Wetland_Protected: -

Inspection Notes:

Certificate of Compliance

() Certificate is Hereby Denied.

(Yes) Certificate is Hereby Granted Based upon the Application, addendum from, plans, specifications and all other supporting data. With Property maintenance, this system can be expected to function satisfactory, however this is not a guarantee.

Signature: David A. Stall

Certification_Date: 11/28/18

Title: ISTS Inspector

Signature

Title

(Certificate of Compliance is not valid unless signed by a Registered Qualified Employee)

PARCEL	
APP	SEPTIC
YEAR	

Type of Drainfield	Full Size of Drainfield	Reduced/Warrantied size
Chamber Trench	_____ sq ft	_____ sq ft
Rock Trench	_____ sq ft	_____ sq ft
Gravelless	_____ sq ft	_____ sq ft
<input checked="" type="checkbox"/> Mound	<u>500</u> sq ft ***	
Pressure Bed	_____ sq ft ***	
Seepage Bed	_____ sq ft ***	
At-grade	_____ sq ft ***	
Alternative / Performance	_____ sq ft ***	***Attach Worksheets

Type of chamber _____
 Depth of Rock 12"
 Alarm? Yes X No _____
 Type of Alarm PS Penton
 Size of Lift Pump 2 HP
 Size of Lift Line 2"

PROPOSED SETBACKS

	TANK	DRAINFIELD
Distance to Well	_____	_____
Distance to Building	_____	_____
Distance to Property Line	<u>10'</u>	<u>10'</u>
Distance to OHW of Lake	<u>75'</u>	<u>75'</u>
Distance to Pressure Line	_____	_____
Distance to Wetland/Protected Water	_____	_____

Perc Rate 3.2 Soil Sizing Factor 1.67 *IF SSF other than .83, attach Perc Test Data

Soil Borings (three are required)

Depth	Texture	Color	Structure	Depth	Texture	Color	Structure
0-6	black			0-6	black		
6-18	sandy 10/12	10y/4/6	blocky	6-16"	sandy 10/12	10y/4/6	
18-	redox			16-redox			

Depth	Texture	Color	Structure	Depth	Texture	Color	Structure
0-5	black						
5-20	sandy 10/12	10y/4/6	blocky				
20-redox							

5. REQUIRED DOCUMENTS

U of MN worksheets are required for mounds, pressure beds, seepage beds, at-grades or Type IV or Type V systems. Are the required worksheets attached? X Yes _____ No

6. DESIGNER'S CERTIFIED STATEMENT

I, Devin A. Bryde certify that I have completed the preceding design work in accordance with all applicable requirements (including, but not limited to Minnesota Chapter 7080 and the Becker County Individual Sewage Treatment System Ordinance).

Signature of Designer Devin A. Bryde Date 9-28-2018



Existing Subsurface Sewage Treatment System (SSTS)

Doc Type: Compliance and Enforcement

Instructions: Inspection results based on Minnesota Pollution Control Agency (MPCA) requirements and attached supporting documentation – additional local requirements may also apply. Further information can be found here: <https://www.pca.state.mn.us/sites/default/files/wq-wwists4-31a.pdf>.

Inspector must submit completed form to Local Governmental Unit (LGU) and system owner within 15 days of final determination of compliance or noncompliance.

Property information

Local tracking number: _____
Parcel ID# or Sec/Twp/Range: 280280102 Local regulatory authority: _____
Property address: 23424 White Pine Rd
Owner/representative: Mike Amb Owner's phone: 701-238-6872
Brief system description: 1500 comp / boost / mound / sand filter

System status

System status on date (mm/dd/yyyy): 10-14-2024

Compliant – Certificate of compliance*

(Valid for 3 years from report date unless evidence of an imminent threat to public health or safety requiring removal and abatement under section 145A.04, subdivision 8 is discovered or a shorter time frame exists in Local Ordinance.)

*Note: Compliance indicates conformance with Minn. R. 7080.1500 as of system status date above and does not guarantee future performance.

Noncompliant – Notice of noncompliance

An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance or under section 145A.04 subdivision 8.

Systems failing to protect ground water must be upgraded, replaced, or use discontinued within the time required by local ordinance.

Reason(s) for noncompliance (check all applicable)

- Impact on public health (Compliance component #1) – Imminent threat to public health and safety
- Tank integrity (Compliance component #2) – Failing to protect groundwater
- Other Compliance Conditions (Compliance component #3) – Imminent threat to public health and safety
- Other Compliance Conditions (Compliance component #3) – Failing to protect groundwater
- System not abandoned according to Minn. R. 7080.2500 (Compliance component #3) – Failing to protect groundwater
- Soil separation (Compliance component #5) – Failing to protect groundwater
- Operating permit/monitoring plan requirements (Compliance component #4) – Noncompliant - local ordinance applies

Comments or recommendations

4208 66th St S
Fargo, ND 58104

Certification

I hereby certify that all the necessary information has been gathered to determine the compliance status of this system. No determination of future system performance has been nor can be made due to unknown conditions during system construction, possible abuse of the system, inadequate maintenance, or future water usage.

By typing my name below, I certify the above statements to be true and correct, to the best of my knowledge, and that this information can be used for the purpose of processing this form.

Business name: Bergstrom Bankbox Certification number: 2779
Inspector signature: [Signature] License number: 478
(This document has been electronically signed) Phone: 218-841-9003

Necessary or locally required supporting documentation (must be attached):

- Soil observation logs
- Locally required forms
- Tank Integrity Assessment
- Operating Permit
- Other information (list): _____

1. Impact on public health – Compliance component #1 of 5

Compliance criteria:

System discharges sewage to the ground surface	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
System discharges sewage to drain tile or surface waters.	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
System causes sewage backup into dwelling or establishment.	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No

Any "yes" answer above indicates the system is an imminent threat to public health and safety.

Describe verification methods and results:

Visual

Attached supporting documentation:

- Other: _____
- Not applicable

2. Tank integrity – Compliance component #2 of 5

Compliance criteria:

System consists of a seepage pit, cesspool, drywell, leaching pit, or other pit?	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
Sewage tank(s) leak below their designed operating depth?	<input type="checkbox"/> Yes* <input checked="" type="checkbox"/> No
If yes, which sewage tank(s) leaks:	

Any "yes" answer above indicates the system is failing to protect groundwater.

Describe verification methods and results:

Camera in tank

Attached supporting documentation:

- Pumped at time of inspection
- Name of maintenance business: *Baytown Builders*
- License number of maintenance business: *478*
- Date of maintenance: *10-14-24*
- Existing tank integrity assessment (Attach)
- Date of maintenance (mm/dd/yyyy): _____ (must be within three years)
- (See form instructions to ensure assessment complies with Minn. R. 7082.0700 subp. 4 B (1))
- Tank is Noncompliant (pumping not necessary – explain below)
- Other: _____

3. Other compliance conditions – Compliance component #3 of 5

3a. Maintenance hole covers appear to be structurally unsound (damaged, cracked, etc.), or unsecured?

Yes* No Unknown

3b. Other issues (electrical hazards, etc.) to immediately and adversely impact public health or safety? Yes* No Unknown

**Yes to 3a or 3b - System is an imminent threat to public health and safety.*

3c. System is non-protective of ground water for other conditions as determined by inspector? Yes* No

3d. System not abandoned in accordance with Minn. R. 7080.2500? Yes* No

**Yes to 3c or 3d - System is failing to protect groundwater.*

Describe verification methods and results:

Visual

Attached supporting documentation: Not applicable

4. Operating permit and nitrogen BMP* – Compliance component #4 of 5 Not applicable

Is the system operated under an Operating Permit?

Yes No If "yes", A below is required

Is the system required to employ a Nitrogen BMP specified in the system design? Yes No If "yes", B below is required

BMP = Best Management Practice(s) specified in the system design

If the answer to both questions is "no", this section does not need to be completed.

Compliance criteria:

a. Have the operating permit requirements been met? Yes No

b. Is the required nitrogen BMP in place and properly functioning? Yes No

Any "no" answer indicates noncompliance.

Describe verification methods and results:

Attached supporting documentation: Operating permit (Attach)

5. Soil separation – Compliance component #5 of 5

Date of installation 2018 Unknown
(mm/dd/yyyy)

Shoreland/Wellhead protection/Food beverage lodging? Yes No

Attached supporting documentation:

Soil observation logs completed for the report (Attach)

Two previous verifications of required vertical separation (Attach)

Not applicable (No soil treatment area)

Compliance criteria (select one):

5a. For systems built prior to April 1, 1996, and not located in Shoreland or Wellhead Protection Area or not serving a food, beverage or lodging establishment: Yes No*

Drainfield has at least a two-foot vertical separation distance from periodically saturated soil or bedrock.

5b. Non-performance systems built April 1, 1996, or later or for non-performance systems located in Shoreland or Wellhead Protection Areas or serving a food, beverage, or lodging establishment: Yes No*

Drainfield has a three-foot vertical separation distance from periodically saturated soil or bedrock.*

5c. "Experimental", "Other", or "Performance" systems built under pre-2008 Rules; Type IV or V systems built under 2008 Rules 7080.2350 or 7080.2400 (Advanced Inspector License required) Yes No*

Drainfield meets the designed vertical separation distance from periodically saturated soil or bedrock.

Indicate depths or elevations

A. Bottom of distribution media	72
B. Periodically saturated soil/bedrock	16"
C. System separation	40"
D. Required compliance separation*	36

*May be reduced up to 15 percent if allowed by Local Ordinance.

*Any "no" answer above indicates the system is failing to protect groundwater.

Describe verification methods and results:

Upgrade requirements: (Minn. Stat. § 115.55) An imminent threat to public health and safety (ITPHS) must be upgraded, replaced, or its use discontinued within ten months of receipt of this notice or within a shorter period if required by local ordinance. If the system is failing to protect ground water, the system must be upgraded, replaced, or its use discontinued within the time required by local ordinance. If an existing system is not failing as defined in law, and has at least two feet of design soil separation, then the system need not be upgraded, repaired, replaced, or its use discontinued, notwithstanding any local ordinance that is more strict. This provision does not apply to systems in shoreland areas, Wellhead Protection Areas, or those used in connection with food, beverage, and lodging establishments as defined in law.

PARCEL	
APP	SEPTIC
YEAR	

Type of Drainfield	Full Size of Drainfield	Reduced/Warrantied size
Chamber Trench	sq ft	sq ft
Rock Trench	sq ft	sq ft
Gravelless	sq ft	sq ft
<input checked="" type="checkbox"/> Mound	<u>500</u> sq ft ***	
Pressure Bed	sq ft ***	
Seepage Bed	sq ft ***	
At-grade	sq ft ***	
Alternative / Performance	sq ft ***	*** Attach Worksheets

Type of chamber _____
 Depth of Rock 12"
 Alarm? Yes No
 Type of Alarm P5 Pump
 Size of Lift Pump 2 HP
 Size of Lift Line 2"

PROPOSED SETBACKS
 TANK DRAINFIELD

Distance to Well	<u> </u>	<u> </u>
Distance to Building	<u> </u>	<u> </u>
Distance to Property Line	<u>10'</u>	<u>10'</u>
Distance to OHW of Lake	<u>75'</u>	<u>75'</u>
Distance to Pressure Line	<u> </u>	<u> </u>
Distance to Wetland/Protected Water	<u> </u>	<u> </u>

Perc Rate 32 Soil Sizing Factor 1.67 *If SSF other than .83, attach Perc Test Data

Soil Borings (three are required)

Depth	Texture	Color	Structure	Depth	Texture	Color	Structure
0-6	black			0-6	black		
6-18	sandy 10cm	10y 4/6	blocky	6-16"	sandy 10cm	10y 4/6	
18-	redox			18- redox			

Depth	Texture	Color	Structure	Depth	Texture	Color	Structure
0-5	black						
5-20	sandy 10cm	10y 4/6	blocky				
20- redox							

5. REQUIRED DOCUMENTS

U of MN worksheets are required for mounds, pressure beds, seepage beds, at-grades or Type IV or Type V systems. Are the required worksheets attached? Yes No

6. DESIGNER'S CERTIFIED STATEMENT

I, Paul Eyrich certify that I have completed the preceding design work in accordance with all applicable requirements (including, but not limited to Minnesota Chapter 7080 and the Becker County Individual Sewage Treatment System Ordinance).

Signature of Designer Paul Eyrich Date 9-28-2018



280280102

Certificate of Compliance Inspection Report

Last_Name: Slinger
First_Name: Jonathon
Mailing_Address: 3029 41st Ave Court S
Mailing_City: Moorhead
Mailing_State: MN
Mailing_Zip: 56560

BECKER COUNTY ZONING
915 LAKE AVE
DETROIT LAKES, MN 56501
(218) 846-7314

Parcel_Number: 280280102
Legal_Description: HATFIELDS POINT Block 001 LOT 2
Additional_Parcel:
Sec_Twn_Rge: 30-140-38
Designer_Name_and_Li: Daryl Bergstrom L478
Township_Name: Shell Lake
Inspection- Installer Name and Lic: Bergstrom Backhoe Service L478

Insp- Effluent Screen Installed
Insp- Alarm Required: Yes
Insp- Lift Pump in System: Yes
Insp- Number of Bedrooms: -
Insp- Tank Size: 16002/c + 600
Inspection- Type_of_Drainfield: Mound
Insp- Size of Drainfield: 600
Insp- Soil Verification: +36

Insp- Tank_Dist_to_Well: +50
Insp- Drainfield_Dist_to_Well: +50
Insp- Tank_Dist_to_Bldg: TBD
Insp- Drainfield_Dist_to_Bldg: TBD
Insp- Tank_Dist_to_Property_Line: +10
Insp- Drainfield_Dist_to_Property_Line: +10
Insp- Tank_Dist_to_OHW: +75
Insp- Drainfield_Dist_to_OHW: +75
Insp- Tank_Dist_to_Pressure_Line: +10
Insp- Drainfield_Dist_to_Pressure_Line: +10
Insp- Tank_Dist_to_Wetland_Protected: -
Insp- Drainfield_Dist_to_Wetland_Protected: -

Inspection Notes:

Certificate of Compliance

() Certificate is Hereby Denied.
(Yes) Certificate is Hereby Granted Based upon the Application, addendum from, plans, specifications and all other supporting data. With Property maintenance, this system can be expected to function satisfactory, however this is not a guarantee.

Signature: David A. Stall
Title: ISTS Inspector
Certification Date: 11/28/18

(Certificate of Compliance is not valid unless signed by a Registered Qualified Employee)

Purpose: This form may be used to certify the compliance status of the sewage tank components of the SSTS. This form is not a complete SSTS inspection report, only a tank integrity assessment, and may only certify sewage tank compliance status when entirely completed and signed by a qualified professional. SSTS compliance inspection report forms can be found at: <https://www.pca.state.mn.us/water/inspections>.

Instructions: This form may be completed, and signed, by a Designated Certified Individual (DCI) of a licensed SSTS inspection, maintenance, installation, or service provider business who personally conducts the necessary procedures to assess the compliance status of each sewage tank in the system. A copy of this information should be submitted to the system owner and be maintained by the licensed SSTS business for a period of five (5) years from the assessment date.

When this form is signed by a qualified certified professional, it becomes *necessary supporting documentation* to an Existing System Compliance Inspection Report: Compliance inspection form - Existing system (wg-wwists4-31b). This form can be found on the MPCA website at <https://www.pca.state.mn.us/water/inspections>.

The information and certified statement on this form is **required** when existing septic tank compliance status is determined by an individual other than the SSTS Inspector that submits an inspection report. This form represents a third party assessment of SSTS component compliance and is allowable under Minn. R. 7082.0700, subp. 4 Item (B) subitem (1). This form is valid for a period of three years beyond the signature date on this form unless a new evaluation is requested by the owner or owner's agent or is required according to local regulations. Additional Administrative Rule references for this activity can be found at Minn. R. 7082.0700, subp. 4 Items B, C, and D; 7083.0730 Item C.

Certificate of sewage tank compliance

Affirm all three statements:

- The SSTS does not contain a seepage pit, cesspool, drywell, leaching pit, or other pit.
- It does not contain a sewage tank that was designed to be watertight, but subsequently leaks below the designed operating depth.
- It does not represent an imminent safety threat by reason of unsecured, damaged, or weak maintenance hole cover(s) or other unsafe condition.

Notice of sewage tank non-compliance

Select all that apply:

- The SSTS has a seepage pit, cesspool, drywell, leaching pit, or other pit – "Failure to Protect Groundwater."
- It has a sewage tank that was designed to be watertight, but subsequently leaks below the designed operating depth – "Failure to Protect Groundwater."
- It presents a threat to public safety by reason of unsecured, damaged, or weak maintenance hole cover(s) or other unsafe condition – "Imminent Threat to Public Health or Safety."

Company information

Company name: Bergstrom Beckho
Business license number: 478

Designated Certified Individual (DCI) information

Print name: Darryl Bergstrom
Certification number: 2779

I personally conducted the work described above as a Designated Certified Individual of a Minnesota-licensed SSTS inspection, maintenance, installation, or service provider Business. I personally conducted the necessary procedures to assess the compliance status of each sewage tank in this SSTS.

By typing/signing my name below, I certify the above statements to be true and correct, to the best of my knowledge, and that this information can be used for the purpose of processing this form.

Designated Certified Individual's signature: Darryl Bergstrom
(This document has been electronically signed.)

Date (mm/dd/yyyy): 10-14-24

Mr. A. J. ...


...

Island Lake

0.5 deg incl

1105

poles

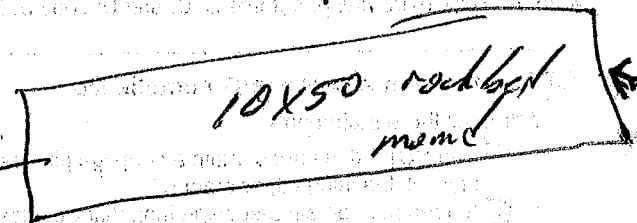

75 ft

10x50 rock bed membrane

no home on site

Prop the

Inspection does not Guarantee or Imply
Future Hydraulic Functioning

Darryl Beyer